

Evaluation Report "Englert® 1" Nailstrip® Metal Roof Assembly

Manufacturer:

Englert, Inc.

**1200 Amboy Avenue
Perth Amboy, NJ 08862
(732) 826-8614**

for

Florida Product Approval

FL 31655.2 R3

Florida Building Code 8th Edition (2023)

Method: 1 - D

Category: Roofing

Sub - Category: Metal Roofing

Product: "1" Nailstrip" Roof Panel

Material: Aluminum


Panel Thickness: 0.032"

Panel Width: 16"

Panel Seam: Snap-Lock

Support: Wood Deck

This item has been electronically signed and sealed by James L. Buckner, P.E., on this date using a Digital Signature. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.




Date: 2023.08.16
'10:53:44 -04'00

Prepared by:

James L. Buckner, P.E., SECB

Florida Professional Engineer # 31242

Florida Evaluation ANE ID: 1916

Project Manager: Diana Galloway

Report No. 23-555-1inNS-A3W-ER

(Revises 21-454-1inNS-A3W-ER, 31655.2 R1, R2)

Date: 08/16/2023

Contents:

Evaluation Report

Pages 1 – 6

Manufacturer:	Englert, Inc. 1200 Amboy Avenue Perth Amboy, NJ 08862 (732) 826-8614 http://www.englertinc.com/
Product Name:	“1” Nailstrip”
Product Category:	Roofing
Product Sub-Category	Metal Roofing
Compliance Method:	State Product Approval Rule 61G20-3.005 (1) (d)
Product/System Description:	“1” Nailstrip” Roof Panel 0.032” Aluminum Nailstrip roof panel mechanically attached to Wood Deck with screws.
Product Assembly as Evaluated:	Refer to Page 4 of this report for product assembly components/materials & standards: <ol style="list-style-type: none">1. Roof Panel2. Fasteners3. Adhesive4. Underlayment5. Fire Barrier Board
Support:	Type: Wood Deck (Design of support system is outside the scope of this evaluation.)
	Description: <ul style="list-style-type: none">• 15/32” or greater plywood,• or Wood plank (min. specific gravity of 0.42) Deck attached with 8d ring shank nails per current FBC with fasteners spaced 4” o.c. over 2x wood rafters 24” o.c.
Slope:	Minimum slope: 2:12 (Non-HVHZ) and in compliance with FBC 1507.4.2 2:12 (HVHZ) Per FBC 1515.2 Roof slope shall be in compliance with FBC Chapter 15 based on the type of roof covering, applicable code sections and in accordance with manufacturer's recommendations.
Performance:	Wind Uplift Resistance: <ul style="list-style-type: none">• Design Uplift Pressure: (Refer to “Table A” attachment details herein) Refer to Table A

Specialty Structural Engineering*CBUCK, Inc. Certificate of Authorization #8064***Performance Standards:**

The product described herein has demonstrated compliance with:

- **TAS 125-03 – Standard Requirements for Metal Roofing Systems**

Code Compliance:

The product(s) described herein have demonstrated compliance with the performance standards listed above as referenced in the Florida Building Code 8th Edition (2023).

Evaluation Report Scope:

This product evaluation is limited to compliance with the structural requirements of the Florida Building Code, as related to the scope section to Florida Product Approval Rule 61G20-3.001.

Limitations and Conditions of Use:

- Scope of "Limitations and Conditions of Use" for this evaluation:
This evaluation report for "Optional Statewide Approval" contains technical documentation, specifications and installation method(s) which include "Limitations and Conditions of Use" throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under "Optional Statewide Approval".

- All metal components and fasteners shall be corrosion resistant in accordance with applicable sections of FBC, including but not limited to Sections 1504.3.2, 1506.6 and 1507.4.4. For HVHZ areas, all roofing accessories shall comply with FBC Sections 1517.5 and 1517.6.
- All insulation fasteners, membrane fasteners and stress plates shall comply with FBC Section 1520.4 as applicable.
- The design pressures listed herein is applicable to all roof pressure zones. Rational analysis or extrapolation to enhance pressure is not permitted in HVHZ zones.
- Maximum panel lengths, valleys & panel accessories shall comply with Roofing Application Standard RAS 133 as applicable in HVHZ areas.
- Deck shall be in compliance with applicable building code.
- Fire Classification is outside the scope of Rule 61G20-3 and is therefore not included in this evaluation.
- All panels shall be permanently labeled with the manufacturer's name and/or logo.
- This evaluation report approves the product assembly as described in this report for use in the High Velocity Hurricane Zone (HVHZ) code section. (Dade & Broward Counties)
- Option for application outside "Limitations and Conditions of Use"

Rule 61G20-3.005(1)(e) allows engineering analysis for "project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code". Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.

Quality Assurance:

The manufacturer has demonstrated compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.0005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through Keystone Certifications, Inc. (FBC Organization ID# QUA 1824).

Components/Materials	Roof Panel:	Englert 1" Nailstrip
(by Manufacturer):	Material:	Aluminum
	Thickness:	0.032" (min.)
	Panel Widths:	16" (max.) Coverage
	Rib Height:	1"
	Material Standards:	Per FBC 1507.4.3 (Non-HVHZ), 1518.9 (HVHZ)
	Corrosion Resistance:	Per FBC 1507.4.3(2) (Non-HVHZ), 1518.9 (HVHZ)

Fastener:

Type:	Low Profile Pancake-Head Wood Screw
Size:	#10 x 1"
Corrosion Resistance:	Per FBC 1506.6 & 1507.4.4 (Non-HVHZ), 1518.9 (HVHZ)
Standard:	Per ANSI/ASME B18.6.1 (Non-HVHZ), 1517.5 (HVHZ)

Seam**Adhesive/Sealant:**

Product Name:	Geocel 2320
Type:	One component, tripolymer adhesive
Application Size:	3/8" continuous bead
Application Location:	along nailstrip side of seam along the full length of panel
(Design of adhesive is outside the scope of this evaluation.)	

**Components& Materials:
(by Others)****Underlayment:****Non-HVHZ:**

One of the following per FBC 8th Edition (2023), Section 1507.1.1.

ASTM D226, D1970, D4869, D6757, D8257

Installation shall comply with FBC including Sections 1507.1.1.1, 1507.1.1.2 where applicable and in accordance with roof manufacturer's recommendations.

HVHZ:

One of the following per FBC 8th Edition (2023), Section 1518.2.

ASTM D226, D1970, D4869, D6757, D8257

Installation shall comply with FBC including Sections 1518.2, 1518.2.1, Table, 1518.2.1, 1518.2.2, 1518.2.3, 1518.2.4 where applicable and in accordance with roof manufacturer's recommendations.

Fire Barrier Board:

Any approved fire barrier with current approval.

1/2" min. fire barrier shall be anchored with min. 12 Ga. X 1-1/4" galvanized annular ring shank roofing nails with 32 ga. tin tags spaced 6" o.c. in rows at perimeter and overlaps, and two intermediate staggered rows at 12" o.c.

(Fire classification is outside the scope of this evaluation. Refer to current fire listings for installation of fire barrier & fire rating of this system.)

Installation:**Installation Method:**

(Refer to “**TABLE A**” below and drawings at the end of this evaluation report.)

- Fastener Spacing: **Refer to “TABLE A” Below**
(along the length of the panel)
- Rib Interlock: Snap-Lock
(Panel ribs shall be fully engaged to form an integral snap-lock.)
- Seam Adhesive: Apply along nailstrip side of seam along the full length of panel.
- Minimum fastener penetration thru bottom of support, **3/16”**.
Fasteners attached through panel where there are no pre-drilled nail slots; through underlying underlayment, tin tags and barrier board into plywood deck.
- For panel construction at the end of panels, refer to manufacturer’s instructions and any site-specific design.

TABLE “A”	
1” Nailstrip” (0.032”) (16”) Roof Panel attached to Wood Deck	
ALLOWABLE LOADS	
	METHOD 1
Design Pressure:	- 178.5 PSF
Fastener Spacing:	6” o.c.
Seam Adhesive:	3/8” continuous bead
Notes:	<ul style="list-style-type: none">• Allowable design pressure(s) for allowable stress design (ASD).

Install the “1” Nailstrip” roof panel assembly in compliance with the installation method listed in this report and applicable code sections of FBC 8th Edition (2023). The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer’s installation instructions as a supplemental guide for attachment.

Referenced Data:

1. TAS 125 Uplift Test & ASTM E8
By Intertek Testing, Inc. (FBC Organization ID# TST 3892)
Report No. N0693.02-450-44, Specimens #1-3, Date: 12/06/21
2. Quality Assurance
Keystone Certifications, Inc. (FBC Organization ID# QUA 1824)
Englert, Inc. Licensee #420
3. Certification of Independence
By James L. Buckner, P.E. @ CBUCK Engineering
(FBC Organization # ANE 1916)


**Tests Performed But
Not Evaluated In This
Report:**

1. TAS 100-95 Wind Driven Rain Test
By Intertek Testing, Inc. (FBC Organization ID# TST 3892)
Report No. N0693.01-450-44, Date: 12/06/21


Installation Method
Englert, Inc.

“1” Nailstrip” (0.032” Aluminum) Roof Panel attached to Wood Deck

Drawings

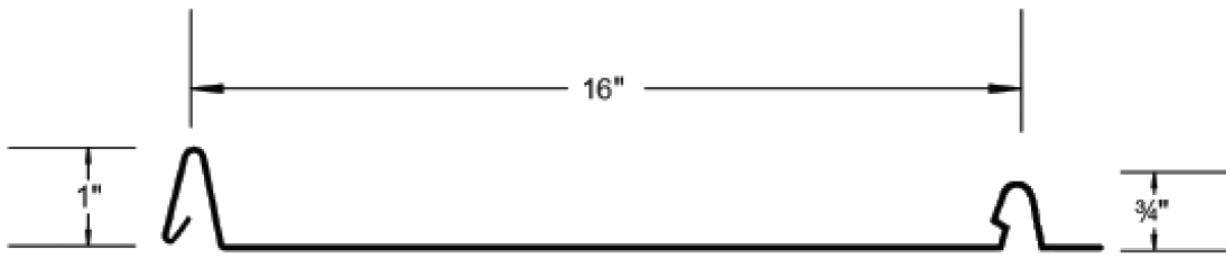

Panel Profile

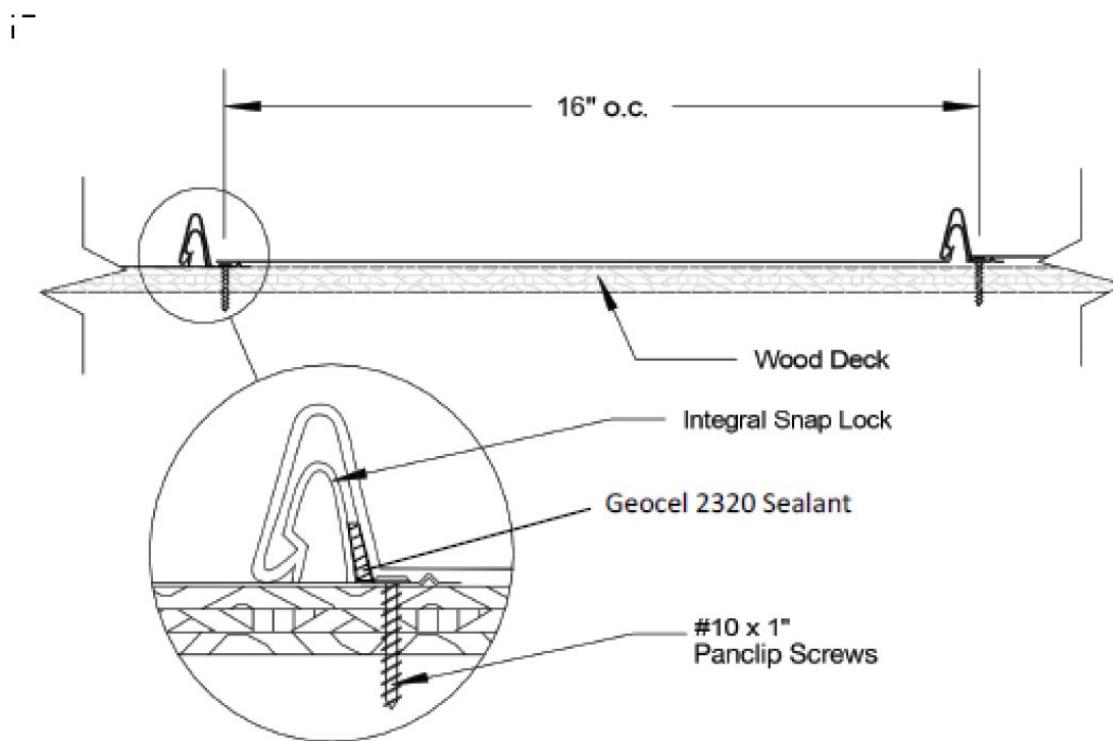

Typical Assembly Profile View